

PK-2

Test Blocks and Plugs



4-pole block with cover



4-pole test plug

Application

For mounting on switchboard panels for use in conjunction with proper test equipment to facilitate the testing of ac instruments, meters and relays.

Features

Type PK-2 test blocks are essentially 4-pole and 6-pole jacks, provided with molded Textolite covers that have internal plug contacts, which make a through connection when the cover is in place. The contacts in the blocks are of the linepressure type and provide positive contact with minimum contact resistance. For all current circuits, auxiliary contacts are used which automatically short circuit the current transformer when the cover, or plug is removed. The test plugs, provided with studs and links, can be permanently connected to the testing equipment for any of the various test methods in use. Routine testing can be accomplished simply by removing the cover and substituting the properly connected test plug; normal connections are restored by replacing the cover.

Contact rating is 250 volts, 10 amperes continuously.

Explanation of Listing

The Cat. No. for each form of block includes the PK-2 block and cover with a set of unmounted auxiliary contacts, jumpers, and screws in sufficient variety and quantity to provide the combinations to suit any application desired, typical arrangements of which are shown in Fig. 10 to 15 inclusive. The Cat. No. and price include mounting screws, nuts for the studs, and (for blocks for mounting on 1/8-1/2-inch panels) bushings for the studs. Test links for test plug are supplied with the plug: 4 with the 4-pole, 6 with the 6-pole.

PK-2 Test Blocks with Covers

4-POLE			6-POLE		
Catalog Number ¹			Catalog Number ¹		
Surface Mounting on 1-, 1.5-, 2-inch panels (Fig. 3 and 5)	Semiflush Mounting on 1/8-inch panels or Surface Mounting on 1/8-in. to 1/2 inch panels (Fig. 3 and 6 or 7)	Net Weight in lb	Surface Mounting on 1-, 1.5, 2-inch panels (Fig. 4 and 5)	Semiflush Mounting on 1/8-inch panels or Surface Mounting on 1/8-inch to 1/2 inch panels !Fig. 4 and 6 or 7)	Net Weight in lb
6422120G1	6422120G3	2	6422120G2	6422120G4	3

¹ - Auxiliary Contacts, jumpers, screws, mounting screws, and bushings, as required, included in catalog number and price.

Test Plugs (Fig. 2 and 8)

4-POLE		6-POLE	
Catalog Number	Net Weight in lb	Catalog Number	Net Weight in lb
6129533G1	1.25	6129533G2	1.75



GE VERNOVA

Dimensions

Subject to change and not to be used for construction without approval.




Fig. 3: 4 Pole




Fig. 4: 6 Pole

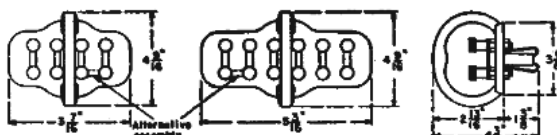


Fig. 8: 4- and 6- Pole Studs




Fig. 9: Semi-flush Mounting Steel Panel only.




Fig. 5: 4- or 6- Pole Surface Mounted on 1 to 2 in. Panels




Fig. 6: Semi-flush Mounted on 1/8 in. Panel




Fig. 7: Surface Mounted on 1/8 to 1/2 in. Panel

POLES	A	B
4	3 - 9/16"	3 - 15/16"
6	5 - 5/16"	5 - 11/16"

Assembly

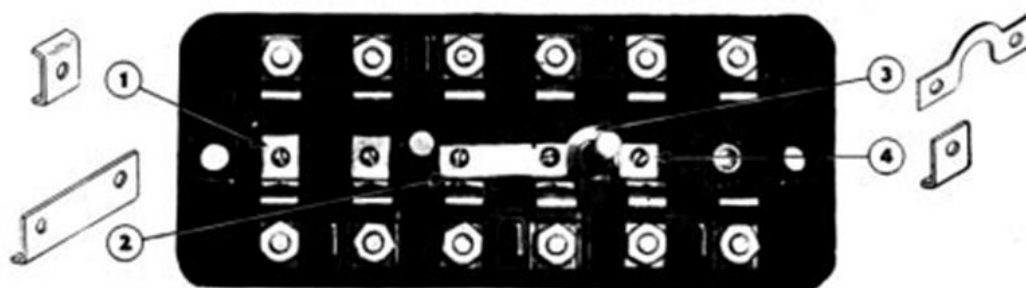


Fig. 9 shows a composite assembly of a 6-pole PK-2 test block with auxiliary contacts and jumpers, as follows:

No. 1 – Auxiliary contact (Cat. No. 6179685G3) used as a bridge to maintain the circuit during the period that the cover or the plug is not in place. Without this connection, loss of revenue is possible because of interrupted operation if the replacement of the cover, or plug, is long delayed.

No. 2 – Auxiliary contact (Cat. No. 6179685G2) to short circuit the current transformer when the cover or plug is not in place.

No. 3 – Jumper (Cat. No. 6179685G4) to be used in connection with auxiliary contact No. 2 or No. 4, to serve the same purpose as No. 2 in short circuiting a current transformer, or to interconnect phases, when the cover-fastening stud is to be by-passed.

No. 4 – Auxiliary contact (Cat. No. 6179685G1) equal to one pole of contact No. 2, to be used in connection with jumper No. 3 as shown in Fig. 9. If all poles are to be

Typical Arrangements of Type PK-2 Test Blocks with Auxiliary Contacts and Jumpers

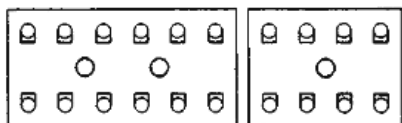


Fig.10: Without Auxiliary Contacts, for Potential Circuits

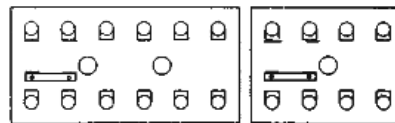


Fig.11: With one Auxiliary Contacts No 2, for Connections as shown in Fig. 16 and 19

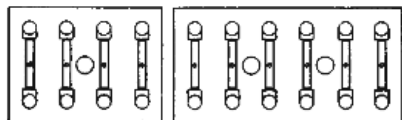


Fig.12: With Auxiliary Contacts No 1, for Through-current Connection

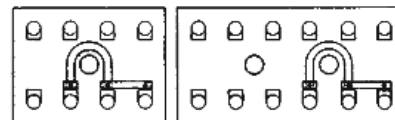


Fig.13: With Auxiliary Contacts No 2 and 4, and Jumpers No 3, for Relay and Trip Connections

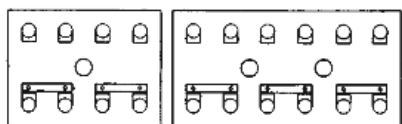


Fig.14: With Auxiliary Contacts No 2, for Current Circuits

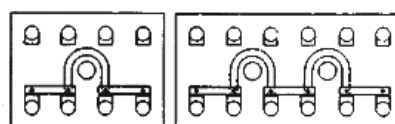


Fig.15: With Auxiliary Contacts No 2, and Jumpers No 3, for Current Transformer Short Circuiting

The above auxiliary contacts and jumpers are furnished with the purchase of PK-2 blocks, as follows:

6422120G1 or G3	(1) 6179685G1	6422120G2 or G4	(1) 6179685G1
	(2) 6179685G2		(3) 6179685G2
	(4) 6179685G3		(6) 6179685G3
	(1) 6179685G4		(2) 6179685G4

Jumpers and auxiliary contacts are available as a separate item, only as follows:

6422120G8	(1) 6179685G1
	(3) 6179685G2
	(6) 6179685G3
	(2) 6179685G4

Schematic Connections (Back View)

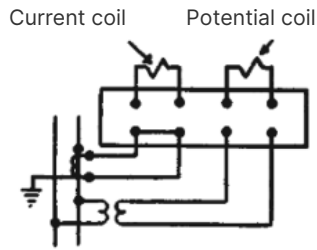


Fig. 16: Test-block connection for one current and one potential coil

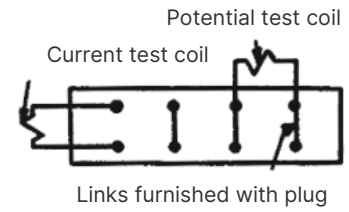


Fig. 17: Plug connection for Fig. 16 for testing one current and one potential coil in circuit

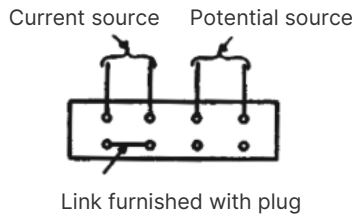


Fig. 18: Plug connection for Fig. 16 for testing one current and one potential coil with separate source

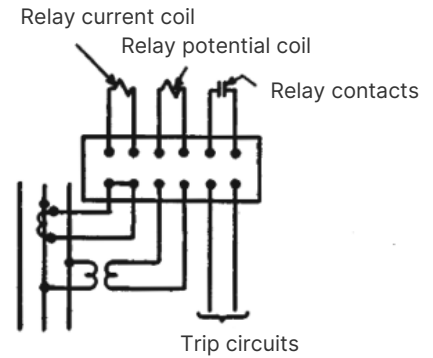


Fig. 19: Test-block connection for one current and one potential coil with connection for trip circuit

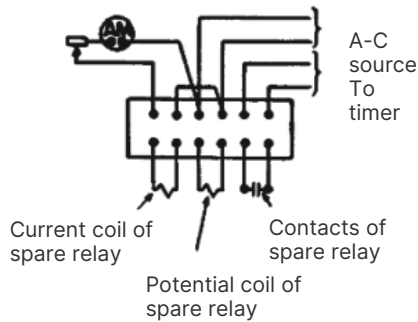


Fig. 20: Plug connection for Fig. 19 for separate test of relay with separate source and spare relay for protection while testing

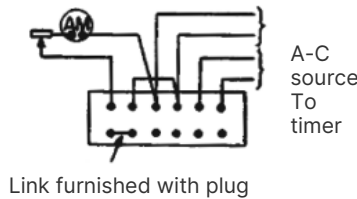


Fig. 21: Plug connection for Fig. 19 for separate test of relay with separate source

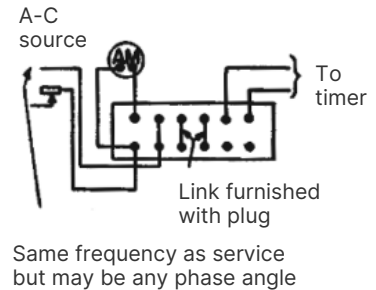


Fig. 22: Plug connection for Fig. 19 for testing relay with same or separate source

For more information, visit
gevernova.com/grid-solutions

Instrument Transformers LLC reserve the right to change specifications of described products at any time without notice and without obligation to notify any person of such changes.

© 2025 GE Vernova and/or its affiliates. All rights reserved. GE and the GE Monogram are trademarks of General Electric Company used under trademark license.



GE VERNOVA

GEA-N50201
English
251008